


C:\Projects\159\159-P5-001\Well modifications 10-2012\Civil-Dwg\As-Recorded\Well Site Plan.dwg
 10/27/2013 9:51 AM
 9/10/2013 11:01 AM Travis L. Zerr
 9/10/2013 9:51 AM
 159-P5-001

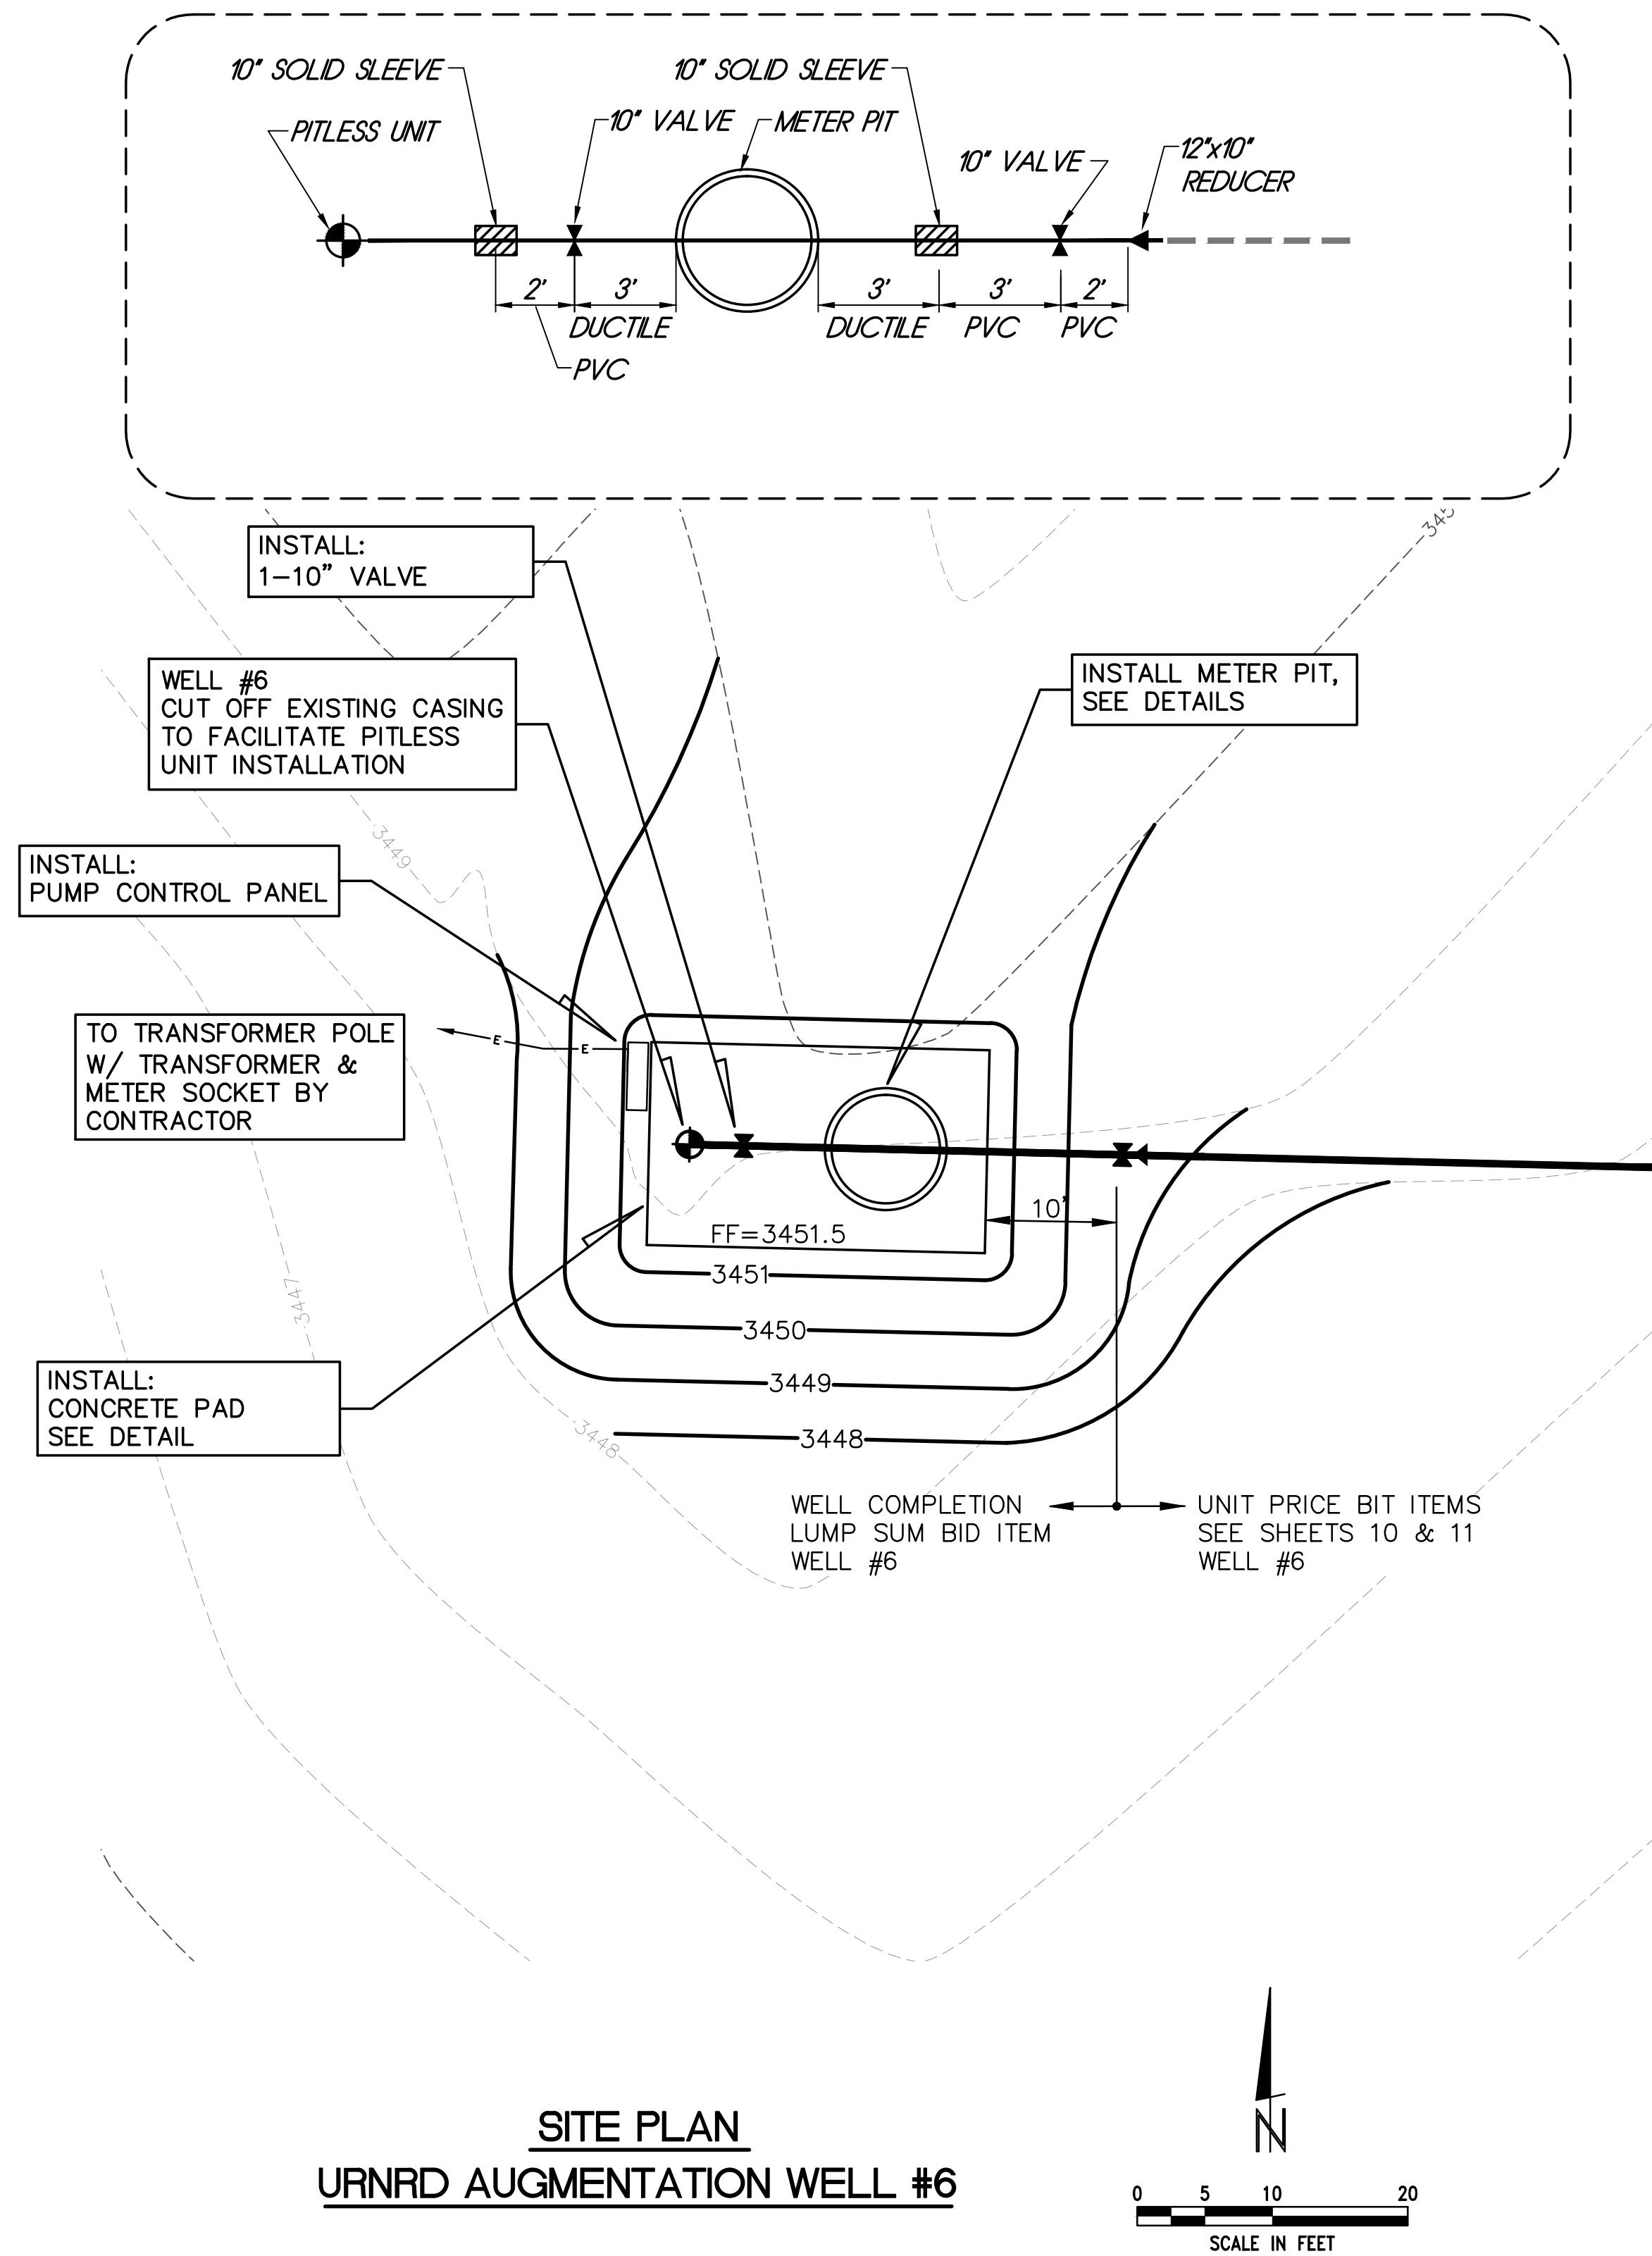


SITE PLAN
 URNRD AUGMENTATION WELL #6

- NOTES:
- ALL 10" WATER MAIN THROUGH METER PIT SHALL BE CLASS 350 DUCTILE.
 - CONTRACTOR TO COORDINATE W/ SWPPD FOR POWER POLE LOCATION/REQUIRED DISCONNECT AND ALL UNDERGROUND FROM POWER POLE TO PANEL BOXES. POWER POLE TO BE MIN. 50' AWAY BUT NO GREATER THAN 75'.
 - CONDUIT RUNS NOT SHOWN.
 - CONTRACTOR VERIFY CONNECTION POINT BURY DEPTH PRIOR TO INSTALLING PITLESS UNIT.
 - PIPING SHALL BE LAID TO ALLOW FOR AIR RELEASE TO EXISTING TRANSMISSION MAIN OR AIR RELEASE IN METER PIT.

| TEST PUMP DATA - WELL #6 | | |
|--------------------------|-------------------|-----------------|
| | START WATER LEVEL | END WATER LEVEL |
| AUG. WELL #6 | 98.969 | 130.72 |
| OLD IRRIGATION WELL #4 | 87.946 | 88.629 |
| OLD IRRIGATION WELL #6 | 77.812 | 79.52 |

| | |
|------------|-------|
| FINAL HP | 100 |
| PUMP BOWLS | 11CLC |
| TRIM | 8.13 |
| STAGE | 1 |

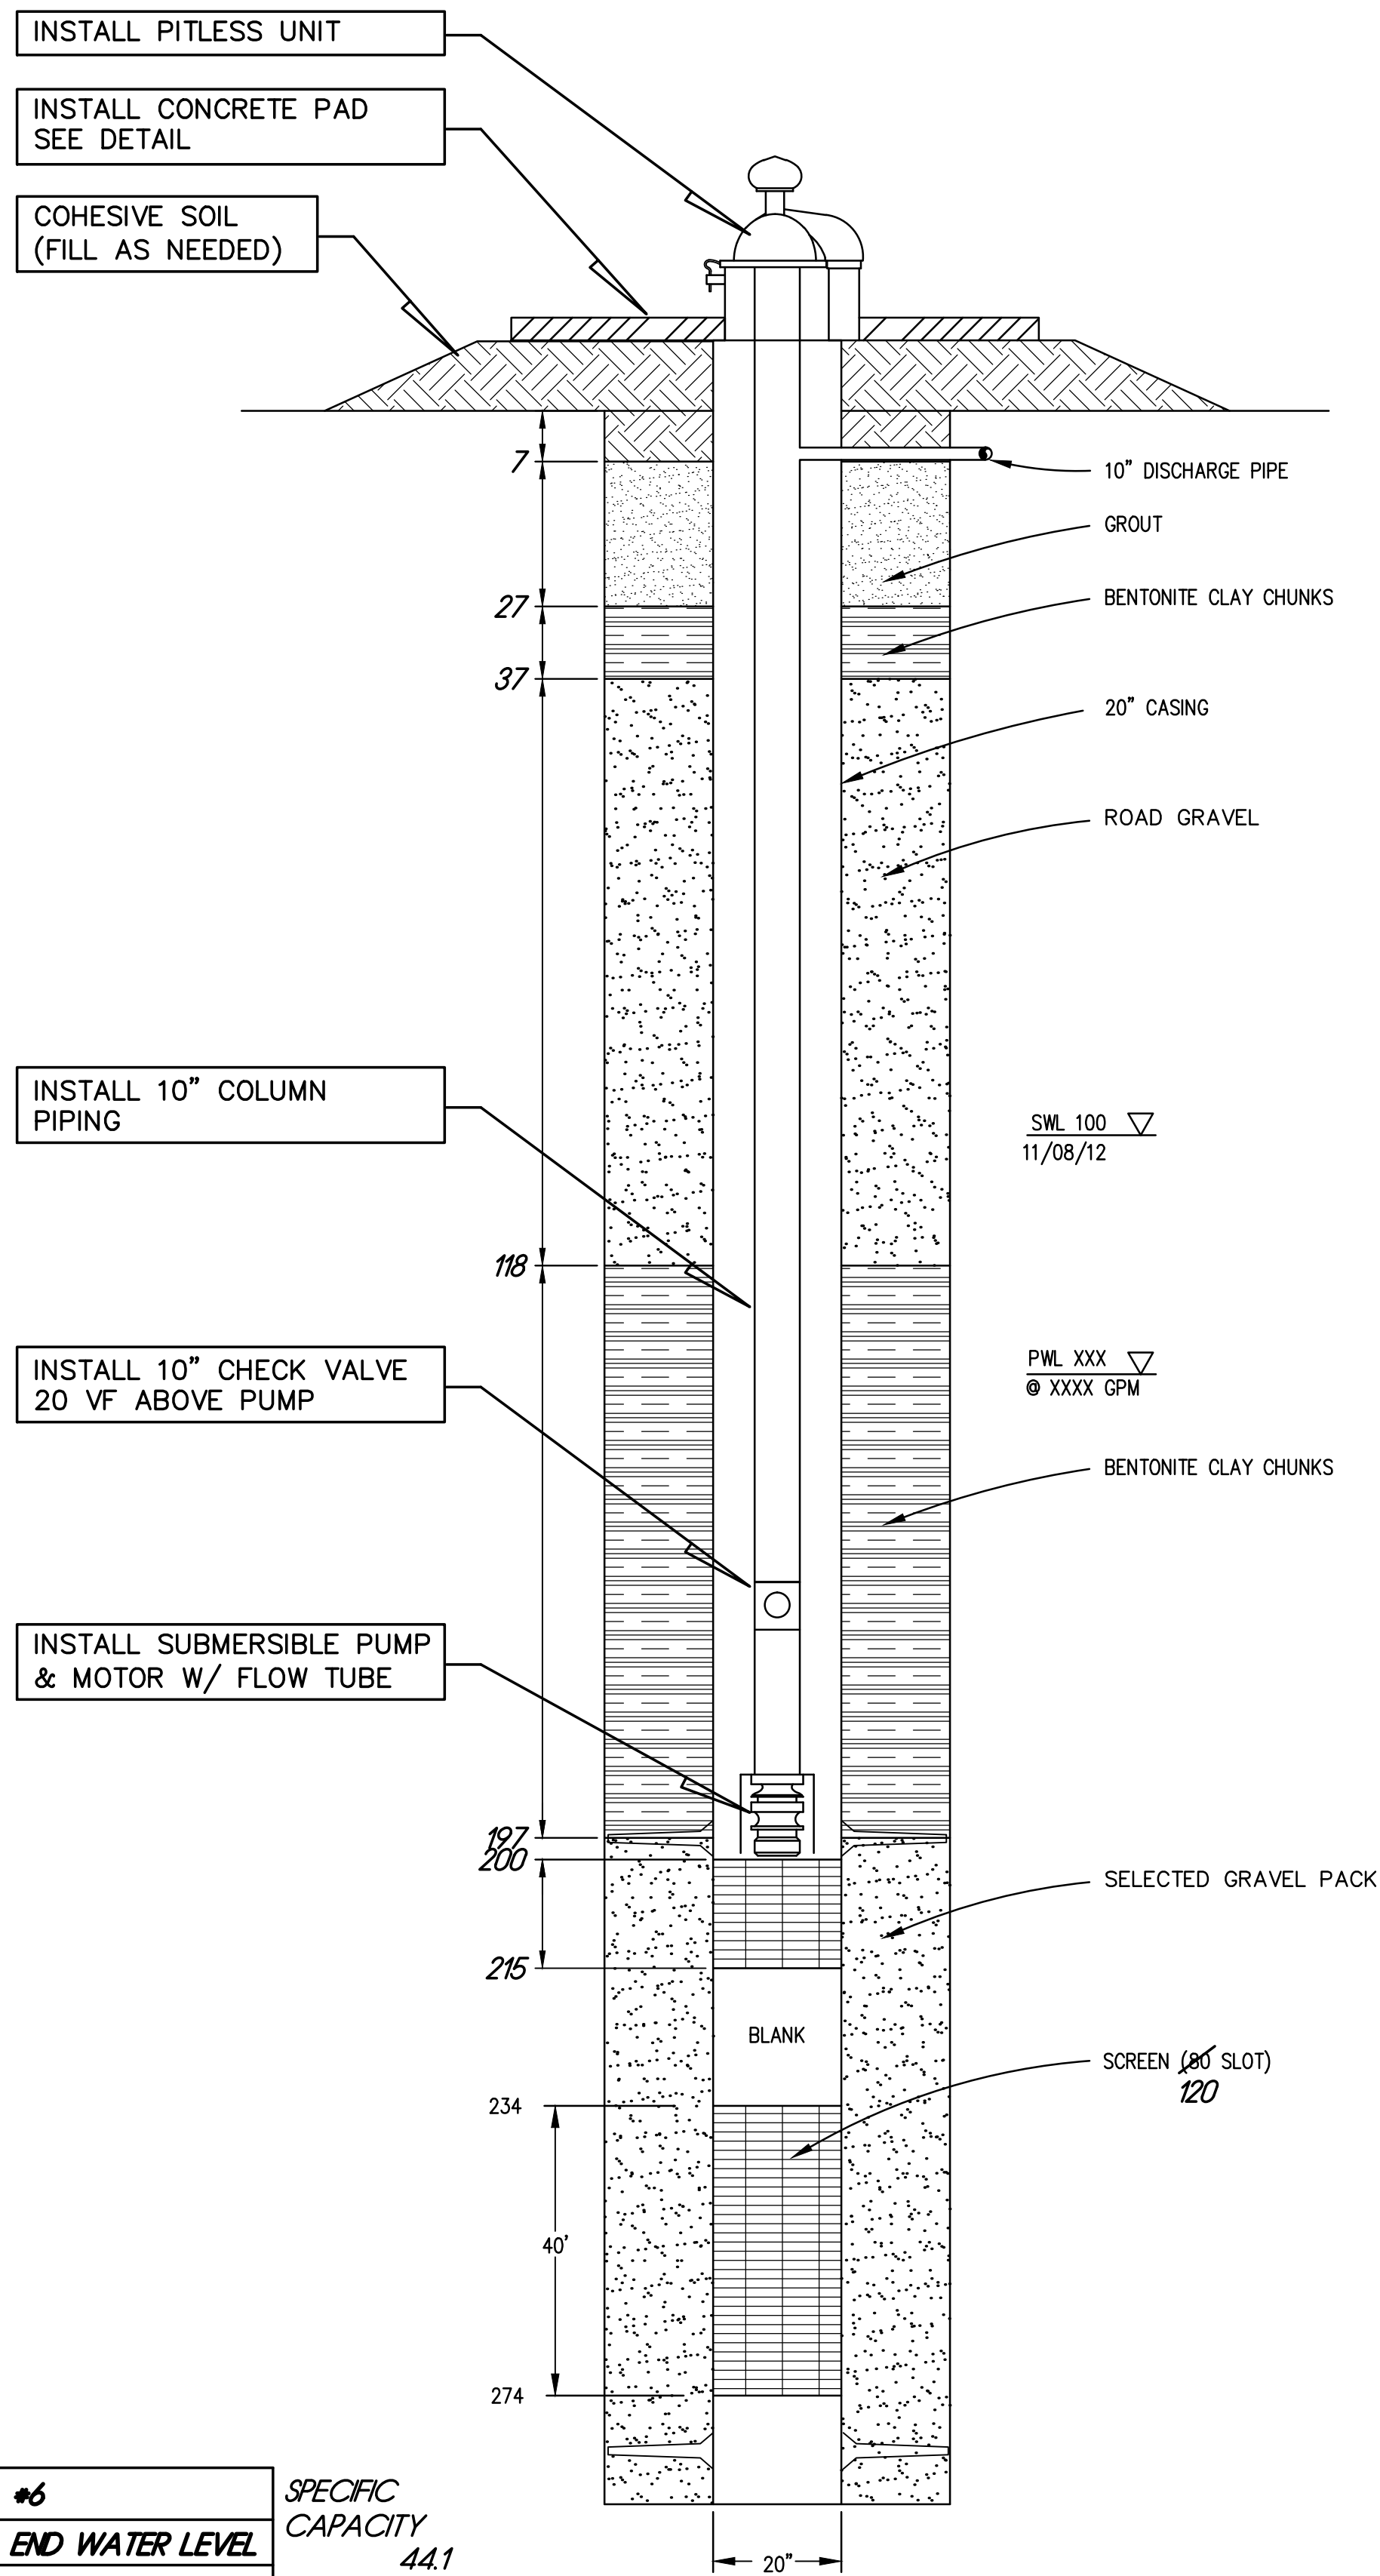

URNRD AUGMENTATION WELL #6
 CONSTRUCTION

REVISIONS
 BY

Miller & Associates
 Consulting Engineers, P.C.
 Kearney, NE (308) 234-6456
 McCook, NE (308) 345-3710

URNRD - AUGMENTATION - WATER SUPPLY WELLS & PIPING
 URNRD AUGMENTATION WELL #6
 DUNDY COUNTY, NEBRASKA

"AS RECORDED"
 FROM INFORMATION PROVIDED BY THE CONTRACTOR.
 DATE: 07-2013 BY: TLZ
 THIS DOCUMENT WAS ORIGINALLY ISSUED AND SEALED BY CHRIS A. MILLER (E-8775), ON 12/10/2012.
 THIS MEDIA SHOULD NOT BE CONSIDERED A CERTIFIED DOCUMENT.

VERIFY SCALES
 BAR IS ONE INCH ON ORIGINAL DRAWING
 0 1"
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY.

SCALE: AS SHOWN
 PROJECT NO. 159-P5-001
 DATE: DECEMBER, 2012
 FIELD BOOK M&A DWG NO. 25311
 DRAWN BY: BSF APRVD BY:
 SHEET 9